

MgO SIP external wall - 100 mm Neopor

Exterior wall
created on 6.4.2019

Thermal protection

$U = 0,14 \text{ W}/(\text{m}^2\text{K})$

EnEV Bestand*: $U < 0,24 \text{ W}/(\text{m}^2\text{K})$




Moisture proofing

No condensate



Heat protection


Temperature amplitude damping: 17
phase shift: 9,8 h
Thermal capacity inside: 28 kJ/m²K

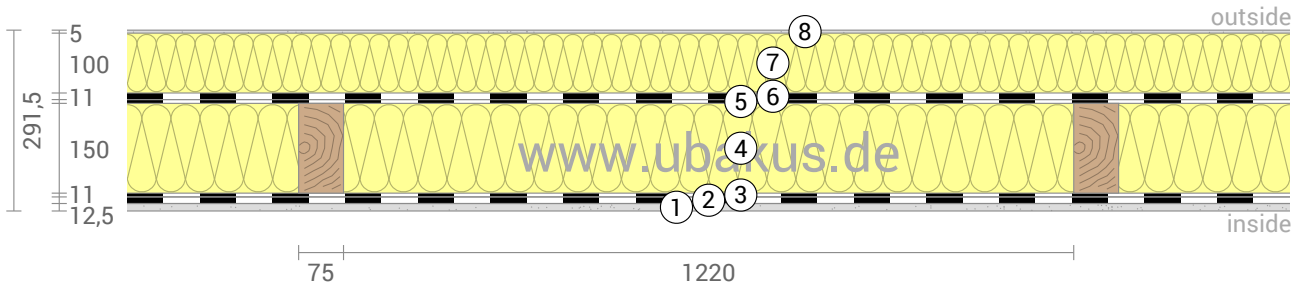

- ① Gypsum (12,5 mm)
- ② Magnesiumoxide board
- ③ Polyurethane Adhesive Macroplast UR 7225B
- ④ EPS 80 (150 mm)
- ⑤ Polyurethan Adhesive Macroplast UR 7225B
- ⑥ Magnesiumoxide board
- ⑦ Neopor WLG032 (100 mm)
- ⑧ Rendering System (5 mm)

Impact of each layer and comparison to reference values

For the following figure, the thermal resistances of the individual layers were converted in millimeters insulation. The scale refers to an insulation of thermal conductivity 0,037 W/mK.

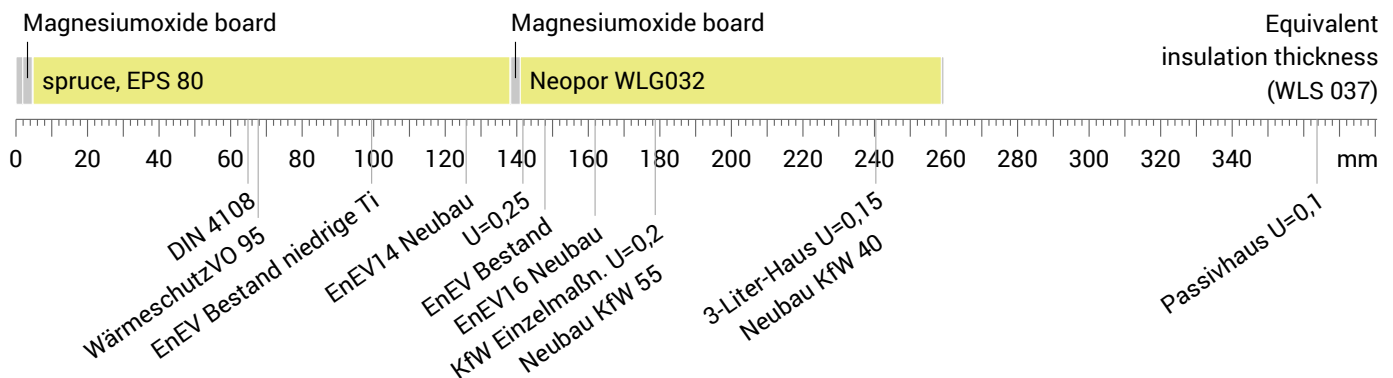

Inside air : 20,0°C / 50%
Outside air: -5,0°C / 80%
Surface temperature.: 18,6°C / -4,9°C

sd-value: 17,5 m

Thickness: 29,2 cm
Weight: 45 kg/m²
Heat capacity: 45 kJ/m²K

MgO SIP external wall - 100 mm Neopor, $U=0,14 \text{ W}/(\text{m}^2\text{K})$

Moisture proofing

For the calculation of the amount of condensation water, the component was exposed to the following constant climate for 90 days: inside: 20°C und 50% Humidity; outside: -5°C und 80% Humidity. This climate complies with DIN 4108-3.


This component is free of condensate under the given climate conditions.

#	Material	sd-value [m]	Condensate [kg/m ²] [Gew.-%]	Weight [kg/m ²]
1	1,25 cm Gypsum	0,05	-	8,5
2	1,1 cm Magnesiumoxide board	0,29	-	10,4
3	0,1 cm Polyurethane Adhesive Macroplast UR 7225B	3,00	-	0,3
4	15 cm EPS 80	6,00	-	2,3
	15 cm spruce (5,8%)	3,00	-	3,9
5	0,1 cm Polyurethan Adhesive Macroplast UR 7225B	3,00	-	0,3
6	1,1 cm Magnesiumoxide board	0,29	-	10,4
7	10 cm Neopor WLG032	5,00	-	1,5
8	0,5 cm Rendering System	0,13	-	7,5
	29,15 cm Whole component	17,52		45,0

Humidity

The temperature of the inside surface is 18,6 °C leading to a relative humidity on the surface of 55%. Mould formation is not expected under these conditions.

The following figure shows the relative humidity inside the component.

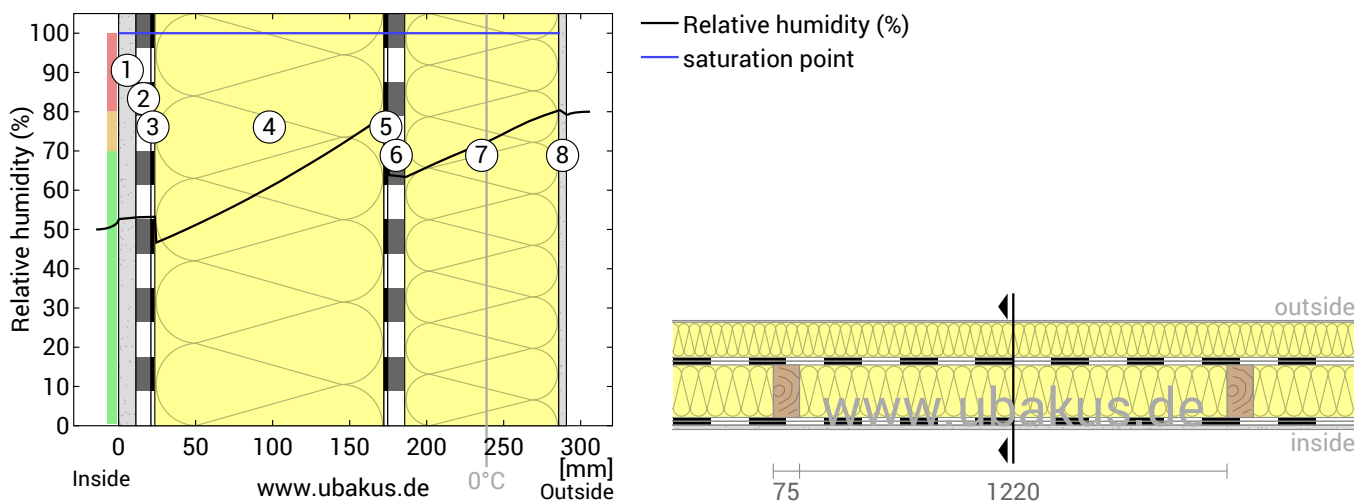



- | | | |
|--------------------------------------|--------------------------------------|---------------------------|
| ① Gypsum (12,5 mm) | ④ EPS 80 (150 mm) | ⑦ Neopor WLG032 (100 mm) |
| ② Magnesiumoxide board | ⑤ Polyurethan Adhesive Macroplast... | ⑧ Rendering System (5 mm) |
| ③ Polyurethane Adhesive Macroplas... | ⑥ Magnesiumoxide board | |

Notes: Calculation using the Ubakus 2D-FE method. Convection and the capillarity of the building materials were not considered. The drying time may take longer under unfavorable conditions (shading, damp / cool summers) than calculated here.

MgO SIP external wall - 100 mm Neopor, $U=0,14 \text{ W}/(\text{m}^2\text{K})$

Heat protection

The following results are properties of the tested component alone and do not make any statement about the heat protection of the entire room:

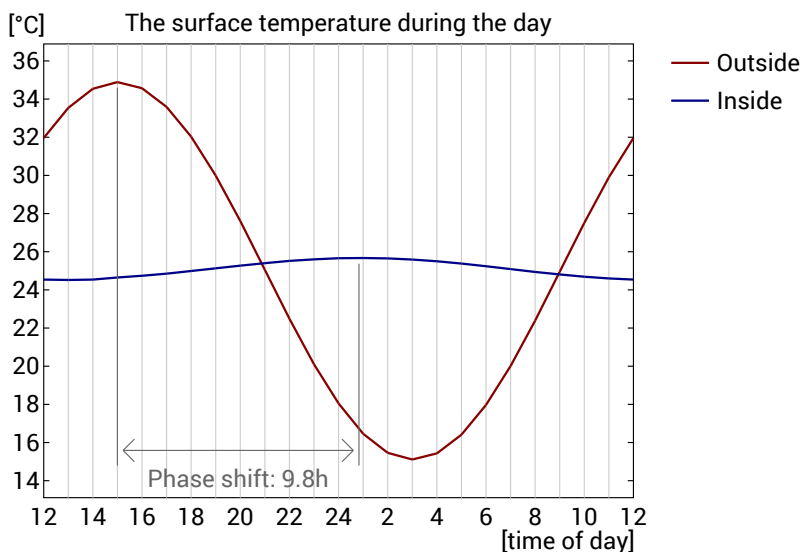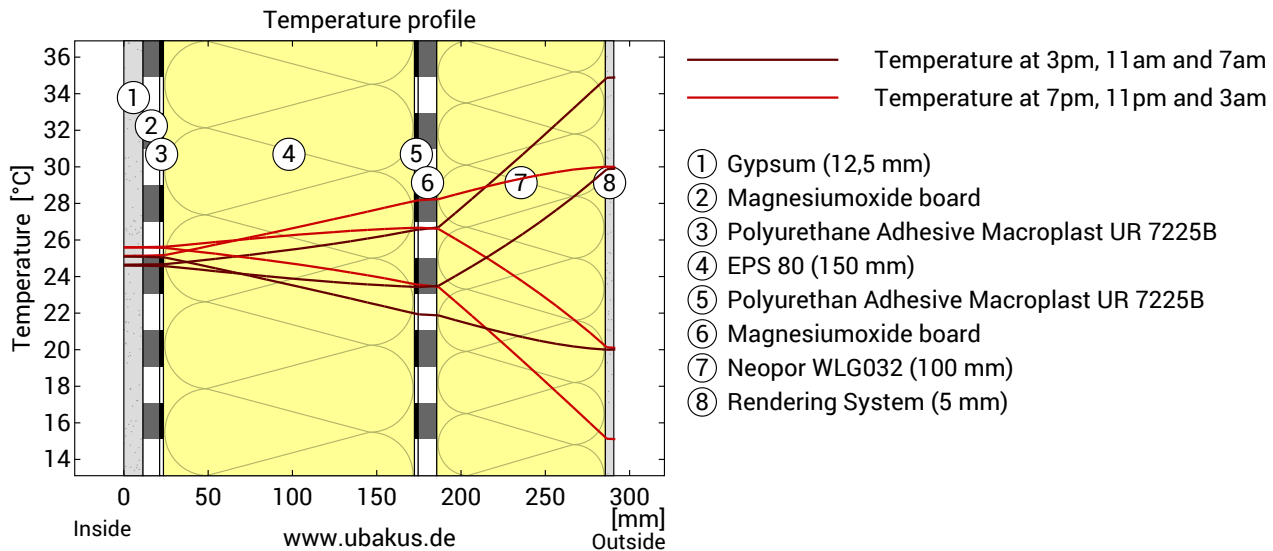

Top: Temperature profile within the component at different times. From top to bottom, brown lines: at 3 pm, 11 am and 7 am and red lines at 7 pm, 11 pm and 3 am.

Bottom: Temperature on the outer (red) and inner (blue) surface in the course of a day. The arrows indicate the location of the temperature maximum values. The maximum of the inner surface temperature should preferably occur during the second half of the night.

Phase shift*	9,8 h	Heat storage capacity (whole component):	45 kJ/m ² K
Amplitude attenuation **	17,1	Thermal capacity of inner layers:	28 kJ/m ² K
TAV ***	0,058		

* The phase shift is the time in hours after which the temperature peak of the afternoon reaches the component interior.

** The amplitude attenuation describes the attenuation of the temperature wave when passing through the component. A value of 10 means that the temperature on the outside varies 10x stronger than on the inside, e.g. outside 15-35 °C, inside 24-26 °C.

*** The temperature amplitude ratio TAV is the reciprocal of the attenuation: $TAV = 1 / \text{amplitude attenuation}$

Note: The heat protection of a room is influenced by several factors, but essentially by the direct solar radiation through windows and the total amount of heat storage capacity (including floor, interior walls and furniture). A single component usually has only a very small influence on the heat protection of the room.

The calculations presented above have been created for a 1-dimensional cross-section of the component.